



XQ2000 SOUND ATTENUATED POWER MODULE

60 Hz

FEATURES



EMISSIONS

EPA and CARB Emissions Certified for non-road mobile applications.



CAT® DIESEL GENERATOR SETS

Factory designed, certified prototype tested with torsional analysis. Production tested and delivered to you in a package that is ready to be connected to your fuel and power lines. Electric Power Design Pro computer sizing available. Supported 100% by your Caterpillar dealer with warranty on parts and labor. Extended warranty available in some areas. The generator set was designed and manufactured in an ISO 9001 compliant facility. Generator set and components meet or exceed the following specifications: AS1359, AS2789, ABGSM TM3, BS4999, DIN6271, DIN6280, EGSA101P, JEM1359, IEC 34/1, ISO3046/1, ISO8528, NEMA MG1-22.



CATERPILLAR® SR4B GENERATOR

Single bearing, wye connected, static regulated, brushless permanent magnet excited generator designed to match the performance and output characteristics of the Caterpillar diesel engine that drives it.



RELIABLE, FUEL EFFICIENT DIESEL

The compact, four-stroke-cycle diesel engine combines durability with minimum weight while providing dependability and economy. The fuel system operates on a variety of fuels.

CATERPILLAR® COOLING SYSTEM

Sized compatible to rating with energy efficient fan and core.

CATERPILLAR® SWITCHGEAR

Single unit or optional paralleling components. Circuit breakers, bus bars, and connection panel ready to connect.

EXCLUSIVE CATERPILLAR® VOLTAGE REGULATOR

Three-phase sensing and adjustable Volts-per-Hertz regulation give precise control, excellent block loading, and constant voltage in the normal operating range.

SOUND ATTENUATED ISO CONTAINER

For ease of transportation and protection. Meets 70 dBA at 50 ft or below per SAE J1074 measurement procedure.

For More Information

Contact

Jerry Coon

Matrix International Corp.

23621 S. Upper Highland
Beavercreek OR 97004 USA
Tele: 503 632-7187
Fax: 503 632-7479

Kevin Mitchell

Matrix International Corp.

2340 FM 740 North
Rockwall TX 75032 USA
Tel.: 972 771-6901
Fax: 972 772-6925

FACTORY INSTALLED STANDARD & OPTIONAL EQUIPMENT

| System | Standard | Optional |
|----------------------|--|--|
| Engine | Air cleaner, with service indicator Batteries Filters: fuel, LH with service indicators; lubricating oil Insulated muffler Jacket water heater Pump, fuel priming — LH Radiator Service meter Standard eight-gauge instrument panel Sump pump Governor Electronic ADEM II | |
| Generator | SR4B brushless, 480 volt, PM excited three-phase with digital voltage regulator, space heater | |
| Containerized Module | Air intake louvers Bus bar access door Fuel tank — 4730 L (1250 Gal) UL listed Fuel/water separator 110 VAC/24 VDC lighting Sound attenuated (75 dBA @ 50 ft) ISO hi cube container Lockable doors Stainless steel hardware and hinges Vertical radiator and exhaust discharge plenum | |
| Cooling | Standard cooling provides 110° ambient at prime rating | |
| Switchgear | Floorstanding switchgear with EMCP II components Automatic start/stop with cooldown timer Battery charger, heavy duty 20A Protection: 32, 59 Circuit breaker, electrically operated Connection terminals, 3-phase and neutral Automatic paralleling Auxiliary power connections for jacket water heater, battery charger, space heaters | Meters: power factor, KW, PF, W/WHM, synchroscope, KVAR Protection: 27, 40, 810, 81U CIM, CCM, remote annunciation Plug and peak shave utility conversion panel |

SPECIFICATIONS.

CAT SR4B GENERATOR

Type Static regulated brushless PM excited
Construction Single bearing, close coupled
Three-phase Wye connected — 6 lead
Insulation Class H — 2 extra dips and
bakes on random wound units
Enclosure Drip proof
Alignment Pilot shaft
Overspeed capability 130%
Voltage regulator 3-phase sensing with
Volts-per-Hertz
Voltage regulation Less than ± 0.5%
Voltage gain Adjustable to compensate for
engine speed droop and line loss
Wave form Less than 5% deviation
TIF Less than 50
THD Less than 3%

CAT® 3516B ENGINE

V-16, 4-stroke-cycle diesel
Bore — mm (in) 170 (6.7)
Stroke — mm (in) 190 (7.5)
Displacement — L (cu in) 69.0 (4210)
Aspiration Turbocharged-Aftercooled

For More Information

Contact

Jerry Coon

Matrix International Corp.

23621 S. Upper Highland
Beavercreek OR 97004 USA
Tele: 503 632-7187
Fax: 503 632-7479

Kevin Mitchell


Matrix International Corp.

2340 FM 740 North
Rockwall TX 75032 USA
Tel.: 972 771-6901
Fax: 972 772-6925

TECHNICAL DATA

| | | | |
|--|--------------------|------------------------------------|---------------|
| Power Rating 60 Hz | kW | Standby 2000 | Prime 1825 |
| Engine and Container Information Engine Model Container size Container dimensions | m (ft) | 3516B 12 (40) see below | |
| Fuel Capacity Hours of Operation at 60% Load Factor 4732 L (1250 Gal) Standard 12 m (40 ft) | hours | 8 | 9 |
| Approximate Weight (Dry) — Container with Generator Set and Switchgear Including Container With Undercarriage | kg (lb) kg (lb) | 32 660 (72,000) 40 370 (89,000) | |

Container Dimensions

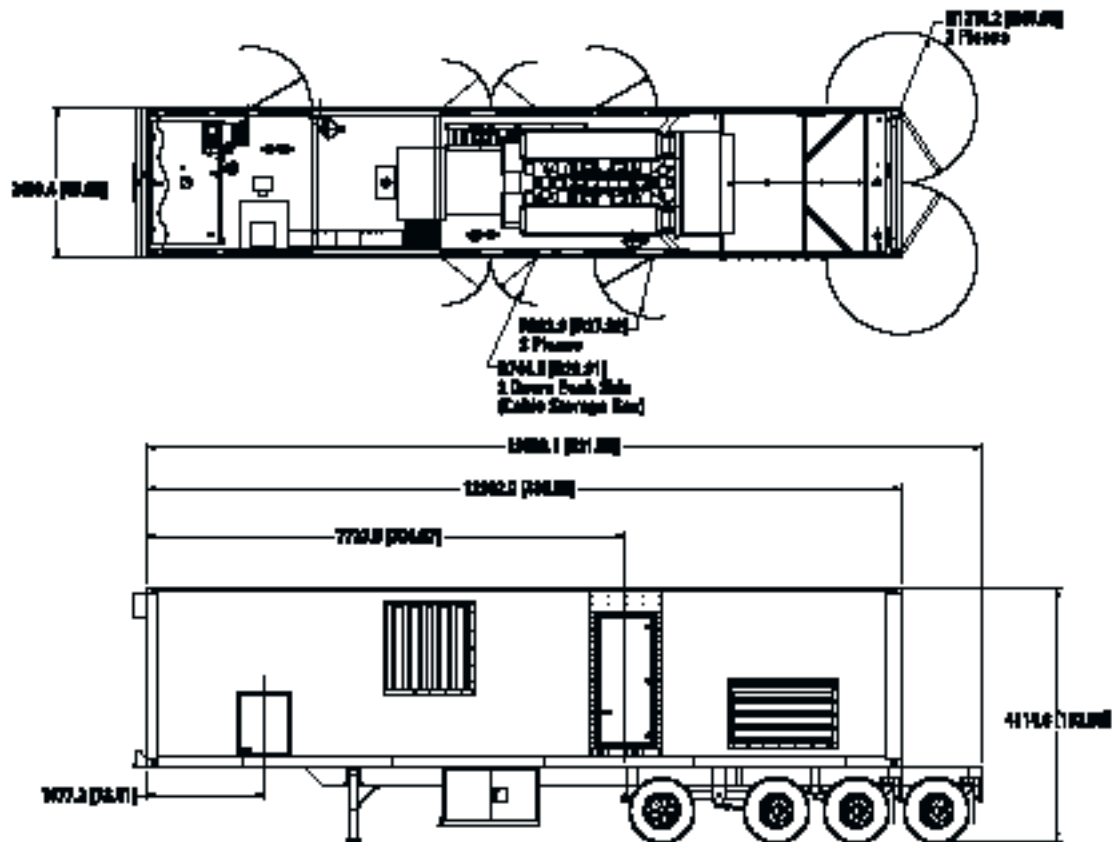

The power module must have support under the center when set on the ground.

| Dimensions | | |
|------------|------------|-----------|
| Length | 13500.1 mm | 531.50 in |
| Width | 2438.4 mm | 96.00 in |
| Height | 4114.8 mm | 162.00 in |

For More Information

Contact

Jerry Coon
Matrix International Corp.
 23621 S. Upper Highland
 Beavercreek OR 97004 USA
 Tele: 503 632-7187
 Fax: 503 632-7479

Kevin Mitchell
Matrix International Corp.
 2340 FM 740 North
 Rockwall TX 75032 USA
 Tel.: 972 771-6901
 Fax: 972 772-6925

STANDARD CONTROLS

12 m (40 ft) CONTAINERS 480V/60 Hz

Floorstanding switchgear includes the following functions and features:

ELECTRONIC MODULAR CONTROL PANEL (EMCP II) COMPONENTS

GENERATOR SET CONTROL (GSC)

Monitoring

Sequentially rotating, backlit LCD display of engine hours, engine rpm, DC battery voltage, oil pressure, and water temperature. Includes pushbutton to hold display on any single parameter.

Protection

Shutdowns:

Overspeed, overcrank, high water temperature, low oil pressure, and emergency stop. With LED indicator for each condition.

Alarms:

Low coolant level

AC Metering

Three-phase volts (L-L), amperes and frequency with phase select pushbutton, on backlit LCD. Metering accuracy is 0.5%.

Control

Automatic starting with field adjustable cycle crank, failure to start (overcrank), and cooldown timer.

Programming and Diagnostics

Includes field programmable set-points for engine control and monitoring variables and self diagnosis of EMCP II system component and wiring failures.

ALARM MODULE

Flashing LED warnings for: low coolant temperature, high coolant temperature (pre-alarm), low oil pressure (pre-alarm), engine control switch not in automatic, and low DC voltage. Includes alarm horn and acknowledge pushbutton.

ENGINE CONTROL SWITCH

Snap action rotary switch, four-position — off/reset, automatic, manual, stop/cooldown. Off/reset for engine shutdown and resetting faults, automatic for remote starting by customer contact closure, manual for local starting and manual paralleling, stop/cooldown for manual operation cooldown.

ALARM ACKNOWLEDGE/LAMP TEST SWITCH

Three-position, spring return to center switch for alarm acknowledge and lamp test of all discrete indicating lamps. Lamp test shall also sound the alarm horn.

ANNUNCIATION CIRCUITS

Upon receipt of an alarm or shutdown condition, the horn shall sound and an LED shall flash. Upon acknowledgement from alarm acknowledge/lamp test switch, the horn shall be silenced and the lamp steadied. LED shall be extinguished when ECS is placed in the off/reset position if the alarm condition has been corrected.

Circuits are recurring such that the LED shall flash and the horn sound, should another fault occur even prior to correction of the initial fault.

EMERGENCY STOP PUSHBUTTON

Mushroom head, twist to reset, causes engine shutdown and tripping of the generator circuit breaker. Prevents engine starting when depressed.

MANUAL PARALLELING

Controls consisting of reverse power relay, synchronizing lights, and switch. Reverse power condition causes tripping of the generator circuit breaker, immediate engine shutdown, flashing of indicating lamp, and sounding of alarm horn.

CIRCUIT BREAKER

Fixed mounted, three-pole, manually operated, molded case circuit breaker with solid state trip unit for overload (time overcurrent) and fault (instantaneous) protection. Includes DC shunt trip coil activated on any generator set monitored fault. Circuit breaker is sized for full load capacity of the generator set at 0.8 power factor.

LOAD SHARE GOVERNOR

Electronic load sharing governor with speed adjust potentiometer, idle/rated switch, and isochronous/droop switch.

VOLTAGE REGULATOR

Standard Caterpillar generator-mounted digital voltage regulator with voltage adjust rheostat mounted in the floorstanding switchgear.

For More Information

Contact

Jerry Coon

Matrix International Corp.

23621 S. Upper Highland
Beavercreek OR 97004 USA
Tele: 503 632-7187
Fax: 503 632-7479

Kevin Mitchell

Matrix International Corp.

2340 FM 740 North
Rockwall TX 75032 USA
Tel.: 972 771-6901
Fax: 972 772-6925

STANDARD CONTROLS (Continued)

CURRENT TRANSFORMERS (3)

Five-ampere secondary with shorting terminal strips

POTENTIAL TRANSFORMERS (3)

120 VAC secondary with primary and secondary fuse protection, two connected to the generator side of the circuit breaker, one connected to the load side of the circuit breaker.

BUS BARS

Three-phase plus fully rated neutral bus bars with NEMA standard hole pattern for connection of customer load cables and generator cables. Bus bars are sized for full load capacity of the generator set at 0.8 power factor. Also includes ground bus, connected to the generator frame ground and container frame with holes for connection of field ground cable. Bus bars are accessible from outside of the power module via hinged, lockable cable access door.

ACCESSORY POWER

3500 Power Modules

Three 230 VAC (50 Hz units) or 120 VAC (60 Hz units) shore power connections for jacket water heaters, generator space heater, and battery charger.

BATTERY CHARGER

24 VDC/20A battery charger with float/ equalize modes and charging ammeter.

For More Information

Contact

Jerry Coon

Matrix International Corp.

23621 S. Upper Highland
Beavercreek OR 97004 USA
Tele: 503 632-7187
Fax: 503 632-7479

Kevin Mitchell

Matrix International Corp.

2340 FM 740 North
Rockwall TX 75032 USA
Tel.: 972 771-6901
Fax: 972 772-6925